


PLAN VIEW
SCALE 1:50

ELEVATION A-A
SCALE 1:50

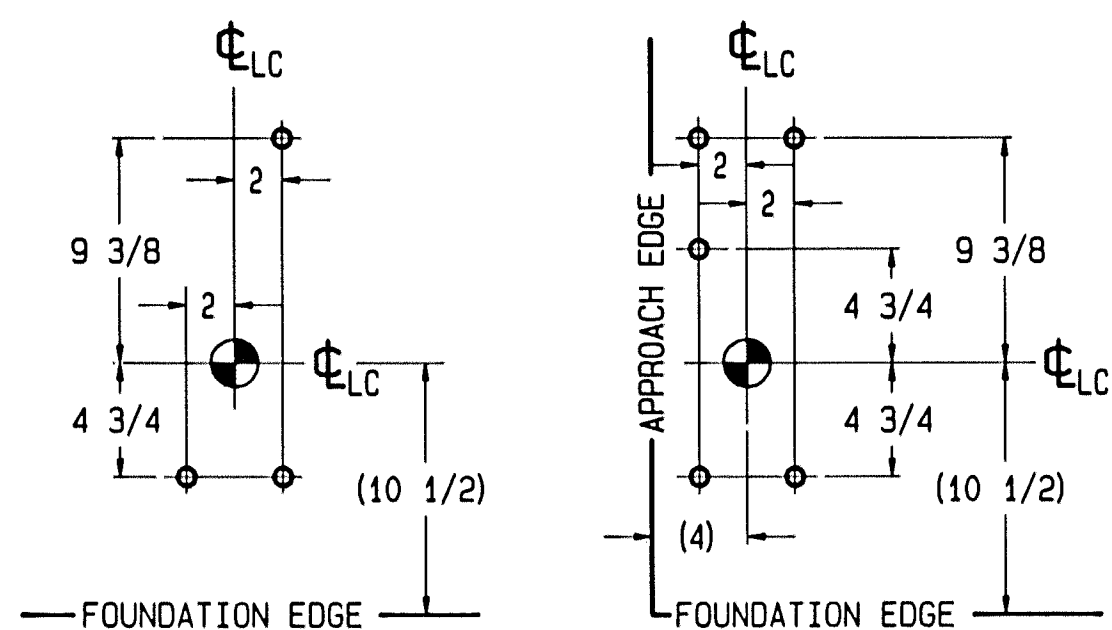


DETAIL "L"

SCALE: 1:8
EXPANSION BOLT LOCATIONS
(OTHER SIDE IS OPPOSITE)


DETAIL "K"

SCALE: 1:8
EXPANSION BOLT LOCATIONS
(OTHER SIDE IS OPPOSITE)

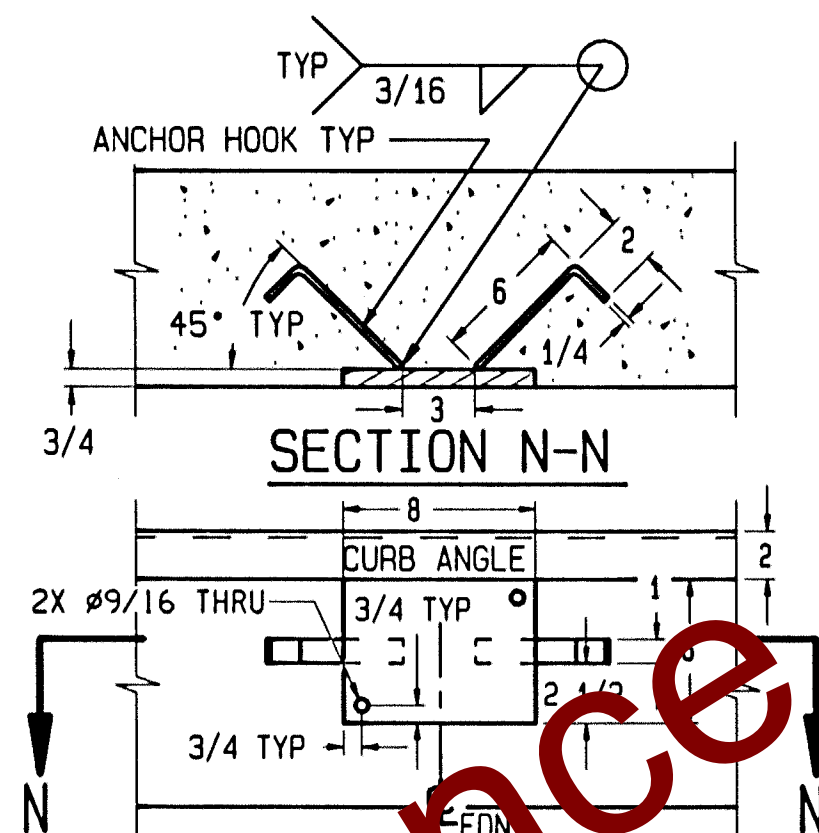


SECTION N-N

SCALE: 1:8
BUMPER PLATE ASSEMBLY: ONE EACH END,
MATERIAL: H.R. STEEL, (BY OTHERS).

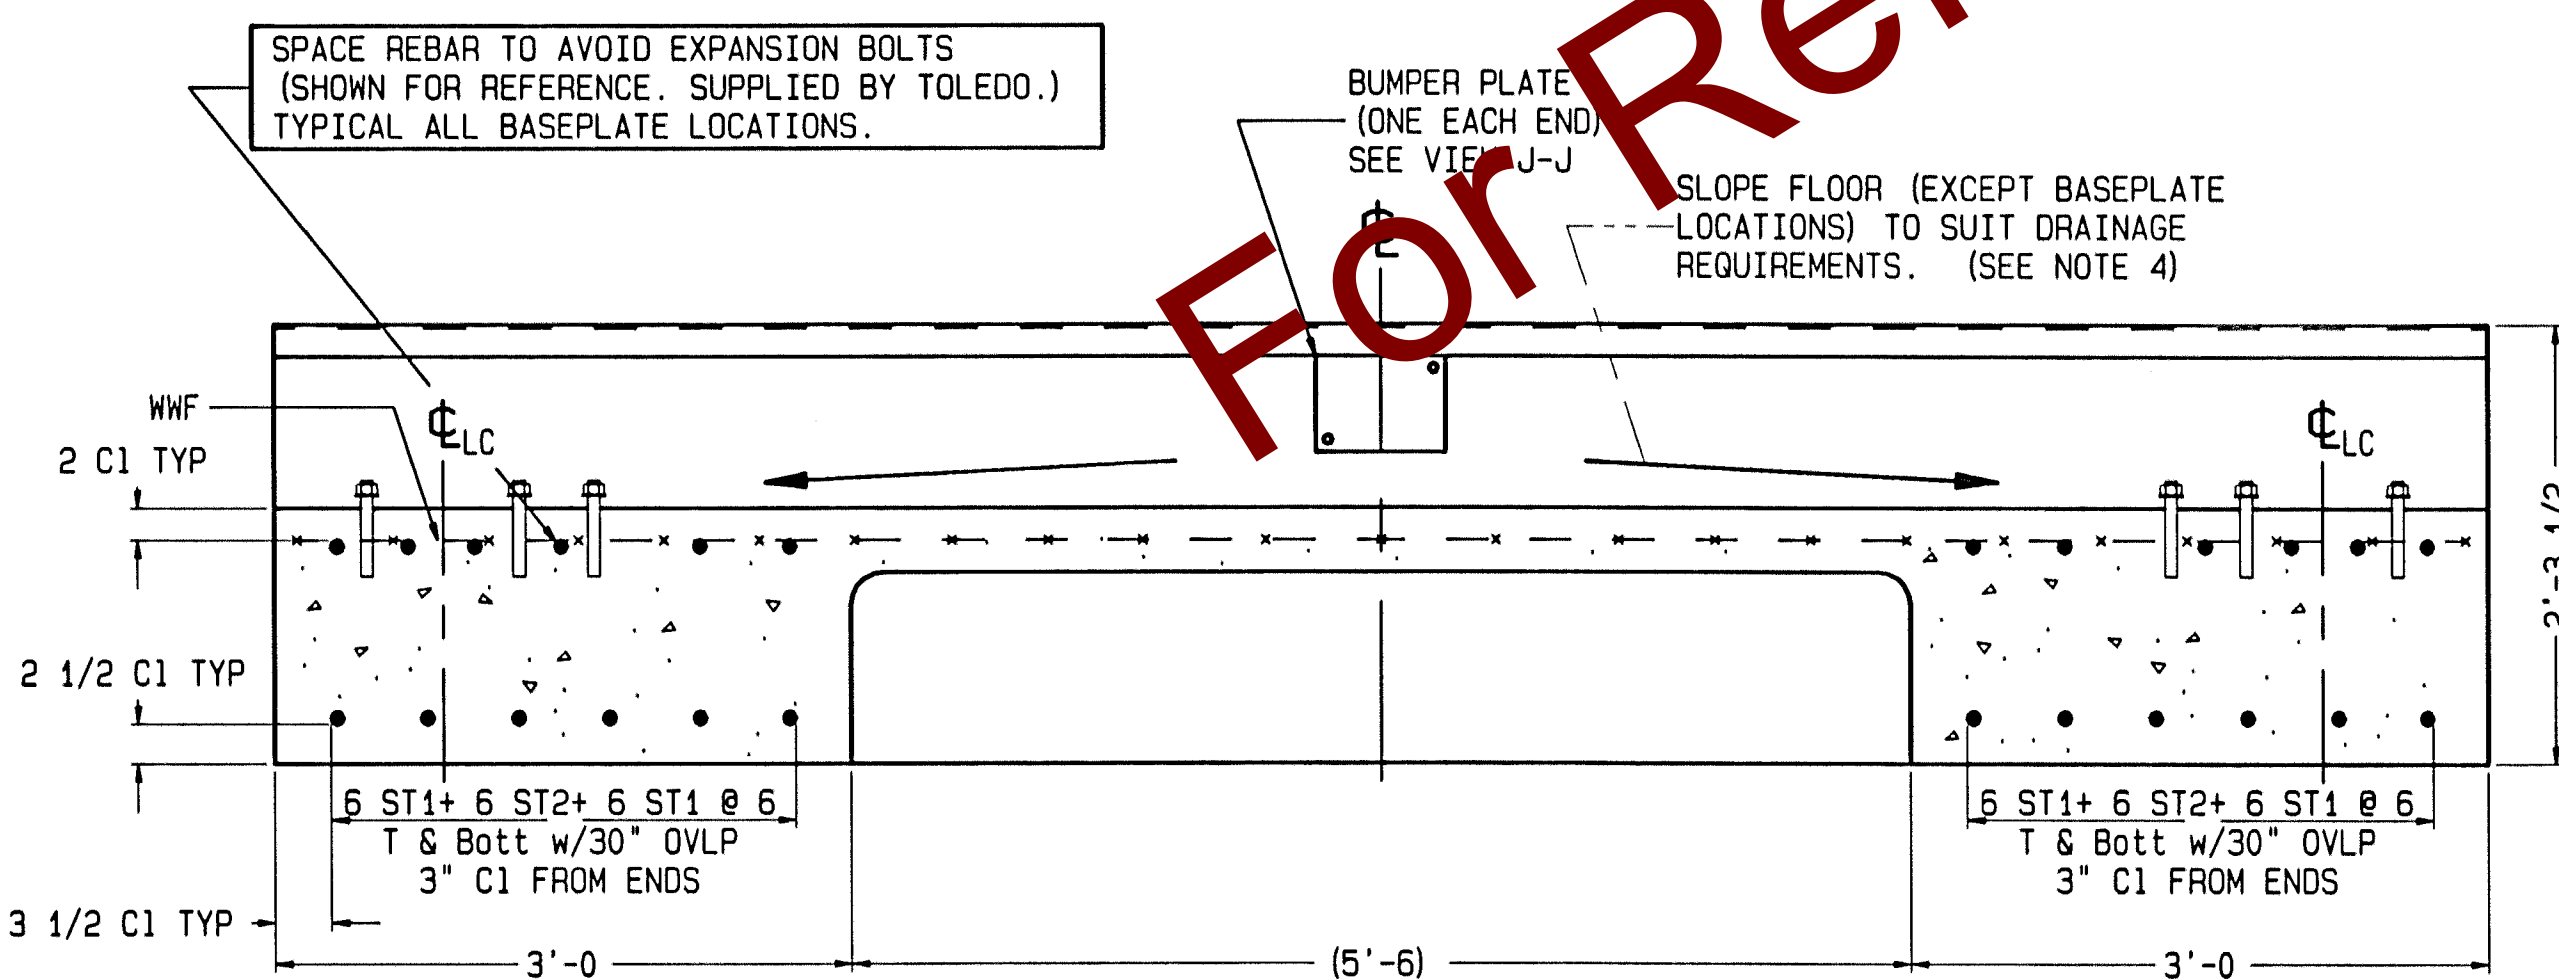


SECTION B-B

SCALE 1:12

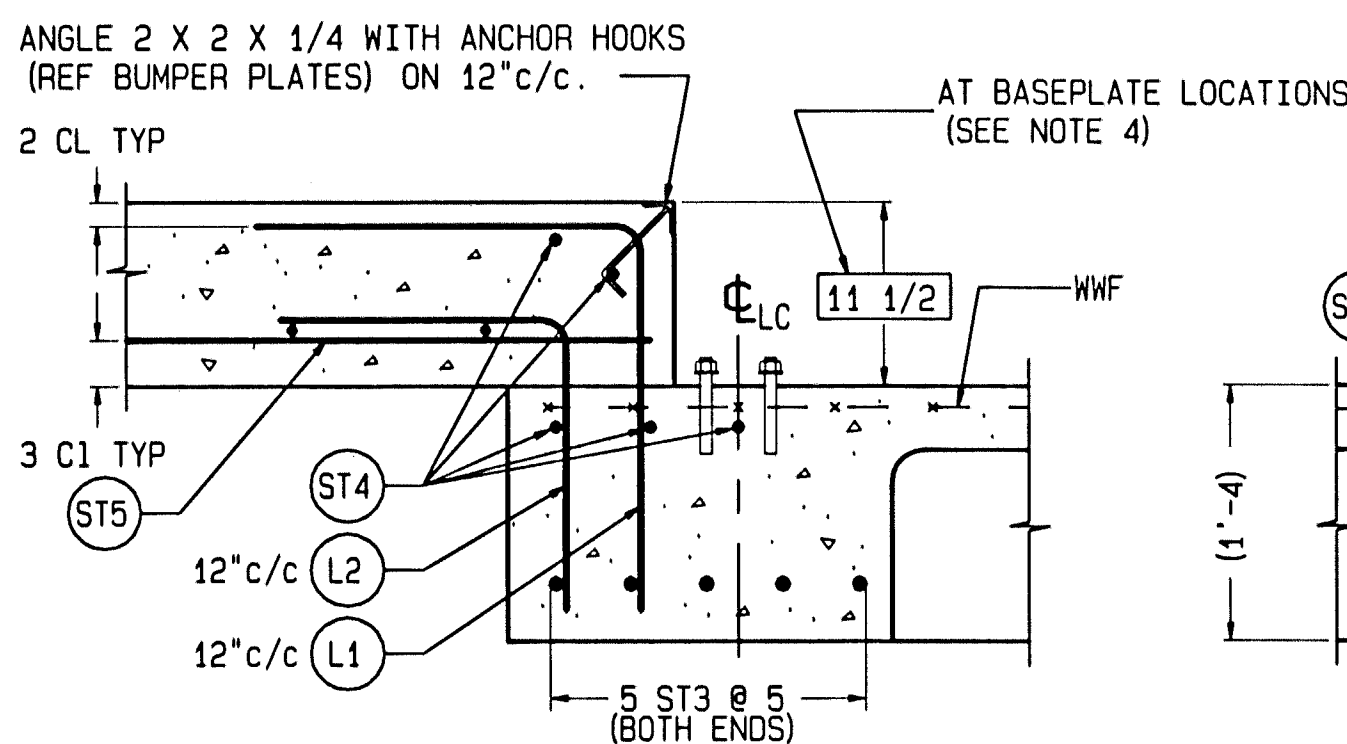

SECTION C-C

SCALE 1:12
(TYPICAL END WALL)

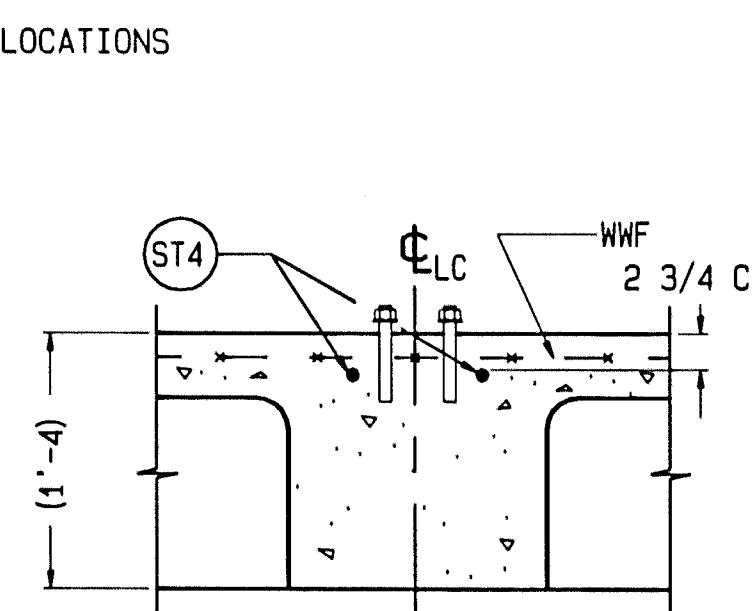

SECTION D-D

SCALE 1:12
(TYPICAL FOOTER)
SINGLE BASEPLATE

REINFORCING STEEL SCHEDULE (A.S.T.M. A-615 GRADE 60)						
COLD FORM BARS TO INSIDE DIMENSIONS			A			
			B			
SYM	QTY	SIZE	LOCATION, DIRECTION	A	B	WGT
ST1	48	#6	FLOOR BEAMS, LONG.	36'-6"		2632
ST2	24	#6	FLOOR BEAMS, LONG.	13'-4"		481
ST3	10	#6	END FOOTERS, LATERAL	11'-0"		165
ST4	10		ENDS, LATERAL			115
	20	#5	APPROACHES, LATERAL	11'-0"		230
	8		FOOTERS, LATERAL			92
ST5	24	#5	APPROACHES, LONG.	9'-6"		238
L1	24	#5	APPROACH TO END TIES	2'-0"	2'-0"	101
L2	24	#5	APPROACH TO END TIES	1'-6"	1'-6"	76

MATERIAL SUMMARY *	
CONCRETE (CU. YDS.)	40
REINFORCING STEEL (LBS)	4130
WWF: 6x6_W1.4xW1.4 (SQ. FT.)	940

* QUANTITIES GIVEN ARE FOR FOUNDATION ONLY. IF CONCRETE PLATFORMS ARE USED, REFER TO GENERAL LAYOUT DRAWING FOR DECK CONCRETE AND REINFORCING STEEL QUANTITIES & SPECS.

NOTES:

- 1) USE MINIMUM 3000 PSI STRENGTH CONCRETE AT 28 DAYS WITH 5-7% AIR ENTRAINMENT.
- 2) USE MINIMUM 60KSI YIELD DEFORMED REINFORCING STEEL.
- 3) FOUNDATION REQUIRES 1500 PSF RATED SOIL.
- 4) TOP OF CONCRETE AT BASEPLATE LOCATIONS TO BE LEVEL AND IN ONE PLANE $\pm 1/8"$.
- 5) DIAGONAL MEASUREMENTS ENDWALL TO ENDWALL MUST BE EQUAL WITHIN $1/2"$.
- 6) BASEPLATE ANCHORS TO BE 3/4" DIA. EXPANSION BOLTS X 6" LG. SUPPLIED BY TOLEDO. USE BASEPLATES AS TEMPLATES TO LOCATE EXPANSION BOLTS DURING SCALE INSTALLATION.
- 7) RAMP LENGTH: -PER LOCAL REGULATIONS
-1/2" SLOPE PER FOOT TYPICAL
- 8) CONTRACTOR SUPPLIES:
 - EXCAVATION
 - REINFORCING STEEL
 - CURB ANGLE ASSEMBLIES (SECT C-C)
 - CONCRETE AND FORMS
 - 1 1/2" DIA CONDUIT
 - BUMPER PLATE ASSEMBLIES (VIEWS J-J & N-N)

MARK	REVISION	BY	DATE	TOLEDO METTLER - TOLEDO, INC. HEAVY CAPACITY PRODUCTS		
A	SHORTENED APPROACHES, REVISED REBAR SCHEDULE	ALS	7-15-91	SCALE: NOTED	TOLERANCE UNLESS OTHERWISE NOTED FRACT $\pm 1/32$ DECIMAL $\pm .020$	DRAWN BY: TDA
B	CORRECTED SECT B-B; ADDED CL NOTES SECT C-C	TDA	2-19-92	DATE: 3/14/91	APPROVED BY:	
				TITLE: 7560A/B FOUNDATION: BEAM SLAB 80'x11'		
				DRAWING NUMBER: TC201572 B		