



Prüf- und Zertifizierungsstelle

ZELM Ex



(1) **EC-TYPE-EXAMINATION CERTIFICATE**
(Translation)

(2) Equipment and Protective Systems Intended for Use in
Potentially Explosive Atmospheres - **Directive 94/9/EC**

(3) EC-TYPE-EXAMINATION CERTIFICATE Number:

ZELM 00 ATEX 0038

(4) Equipment: **Conductivity Transmitter type Cond I 7100 PA**

(5) Manufacturer: **Mettler Toledo GmbH**

(6) Address: **CH - 8902 Urdorf**

(7) This equipment and any acceptable variation thereto are specified in the schedule to this certificate and the documents therein referred to.

(8) The Prüf- und Zertifizierungsstelle ZELM Ex, notified body No. 0820 in accordance with Article 9 of the Council Directive 94/9/EC of 23 March 1994, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment and protective systems intended for use in potentially explosive atmospheres, given in Annex II to the Directive.

The examination and test results are recorded in the confidential report ZELM Ex 0130019048.

(9) Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN 50 014: 1997

EN 50 020: 1994

(10) If the sign "X" is placed after the certificate number, it indicates that the equipment is subject to special conditions for safe use specified in the schedule to this certificate.

(11) This EC-type-examination Certificate relates only to the design and construction of the specified equipment in accordance with Directive 94/9/EC. Further requirements of this Directive apply to the manufacture and supply of this equipment.

(12) The marking of the equipment shall include the following:



II 2 (1) G EEx ia IIC T4

Zertifizierungsstelle ZELM Ex

Braunschweig, June 26, 2000

Dipl.-Ing. Harald Zelm



Sheet 1/3

EC-type-examination Certificates without signature and stamp are not valid. The certificates may only be circulated without alteration. Extracts or alterations are subject to approval by the Prüf- und Zertifizierungsstelle ZELM Ex. In case of dispute, the German text shall prevail.



Prüf- und Zertifizierungsstelle

ZELM Ex



SCHEDULE TO EC-TYPE-EXAMINATION CERTIFICATE ZELM 00 ATEX 0038

Temperature measuring loop
(terminals 7 and 8)

type of protection Intrinsic Safety
resp.

EEx ia IIC/IIB
EEx ib IIC/IIB

maximum values:

$U_o = 5,9 \text{ V}$
 $I_o = 3,71 \text{ mA}$
 $P_o = 5,5 \text{ mW}$
(linear characteristic)

effective internal capacitance: $C_i \leq 250 \text{ nF}$
The effective internal inductance is negligibly small.

IIC resp. IIB

max. permissible external inductance 1000 mH 1000 mH
max. permissible external capacitance 42,7 μF 1000 μF

(only valid if external inductance and external capacitance
do not exist in concentrated form at the same time)

IIC resp. IIB

max. permissible external inductance 1 mH 5 mH
max. permissible external capacitance 1,85 μF 6,85 μF

(also valid if external inductance and external capacitance
exist in concentrated form at the same time)

EP
(terminal 9)

for the connection to the equipotential bonding system

References:

Connecting the equipotential bonding is absolutely required to guarantee electrostatic leakage.

The BUS- / Supply loop is safely electrically isolated from the other loops up to a voltage of 60 V.

The operation manual has to be considered.

(16) Report No.

ZELM Ex 0130019048

(17) Special conditions for safe use

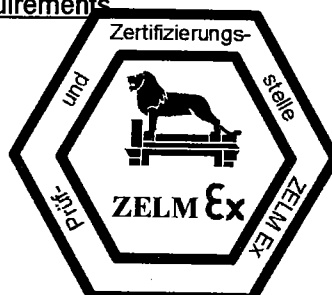
not applicable

(18) Essential Health and Safety Requirements

met by standards

Zertifizierungsstelle ZELM Ex

Dipl.-Ing. Harald Zelm



Braunschweig, June 26, 2000

Sheet 3/3

EC-type-examination Certificates without signature and stamp are not valid. The certificates may only be circulated without alteration. Extracts or alterations are subject to approval by the Prüf- und Zertifizierungsstelle ZELM Ex. In case of dispute, the German text shall prevail.



Prüf- und Zertifizierungsstelle

ZELM Ex



1. Supplement

(Supplement according to EC-Directive 94/9 Annex III letter 6)

to EC-type-examination Certificate

ZELM 00 ATEX 0038

Equipment: **Conductivity Transmitter Type Cond Ind 7100e FF**
Manufacturer: **Mettler-Toledo GmbH**
Address: **Im Hackacker 15, CH – 8902 Urdorf**

Description of supplement

The Conductivity Transmitter Type Cond Ind 7100 PA was extended by the Conductivity Transmitter Type Cond Ind 7100e FF with Foundation Fieldbus communication interface.

The type of protection, the electrical and all further data of the device remain unchanged.

The Foundation Fieldbus version of the Transmitter may be manufactured in future in consideration of this supplement.

References:

The Operating Instructions has to be considered.

Report No.: ZELM Ex 1030417316

Special conditions for safe use

not applicable

Essential Health and Safety Requirements

met by adherence to the standards


EN 50 014: 1997+A1+A2

EN 50 020: 1994

Zertifizierungsstelle ZELM Ex



Braunschweig, October 28, 2004


Dipl.-Ing. Harald Zelm

Sheet 1 / 1

EC-type-examination Certificates without signature and stamp are not valid. The certificates may only be circulated without alteration. Extracts or alterations are subject to approval by the Prüf- und Zertifizierungsstelle ZELM Ex. This English version is based on the German text. In the case of dispute, the German text shall prevail.

Prüf- und Zertifizierungsstelle ZELM Ex • Siekgraben 56 • D-38124 Braunschweig



Prüf- und Zertifizierungsstelle

ZELM Ex



2. Supplement

(Supplement according to EC-Directive 94/9 Annex III letter 6)

to EC-type-examination Certificate

ZELM 00 ATEX 0038

Equipment: **Conductivity Transmitter type Cond I 7100 PA
Conductivity Transmitter type Cond Ind 7100e FF**

Manufacturer: **Mettler-Toledo GmbH**

Address: **Im Hackacker 15, CH – 8902 Urdorf**

Description of supplement

With this 2. Supplement the Conductivity Transmitter type Cond I 7100 PA and type Cond Ind 7100e FF are extended by the type Cond I 7100 PA /1 and the type Cond Ind 7100e FF /1.

The Conductivity Transmitter may also be manufactured in future under consideration of this 2. Supplement.

The type of protection, the electrical data except for the conductivity measuring loop and all other data remain unchanged.

Electrical data

conductivity measuring loop
(terminals 1, 2, 3, 4 and 5)

type of protection Intrinsic Safety
resp.

EEx ia IIC/IIB
EEx ib IIC/IIB

maximum values:

$U_o = 6,9 \text{ V}$
 $I_o = 98,5 \text{ mA}$
 $P_o = 73 \text{ mW}$
(trapezoidal characteristic)

effective internal capacitance:

$C_i \leq 3 \text{ nF}$

The effective internal inductance is negligibly small.

	IIC	resp.	IIB
max. permissible external inductance	2 mH		5 mH
max. permissible external capacitance	500 nF		3 μF

or

	IIC	resp.	IIB
max. permissible external inductance	0,5 mH		2 mH
max. permissible external capacitance	1,6 μF		6 μF



2. SUPPLEMENT OF THE EC-TYPE-EXAMINATION CERTIFICATE ZELM 00 ATEX 0038

temperature measuring loop
(terminals 7 and 8)

type of protection Intrinsic Safety
resp.

EEx ia IIC/IIB
EEx ib IIC/IIB

maximum values:

$U_o = 5,9$ V
 $I_o = 3,71$ mA
 $P_o = 5,5$ mW
(linear characteristic)

effective internal capacitance:

$C_i \leq 250$ nF

the effective internal inductance is negligibly small

	IIC	resp.	IIB	
max. permissible external inductance	1000	mH	1000	mH
max. permissible external capacitance	42,7	μ F	1000	μ F

(only valid if external inductance and external capacitance do not exist in concentrated form at the same time)

	IIC	resp.	IIB	
max. permissible external inductance	1	mH	5	mH
max. permissible external capacitance	1,85	μ F	6,85	μ F

(also valid if external inductance and external capacitance exist in concentrated form at the same time)

or

conductivity measuring loop and
temperature measuring loop
(terminals 1 to 8)

type of protection Intrinsic Safety
resp.

EEx ia IIC/IIB
EEx ib IIC/IIB

maximum values:

$U_o = 12,8$ V
 $I_o = 102,21$ mA
 $P_o = 78,5$ mW
(trapezoidal characteristic)

effective internal capacitance:

$C_i \leq 253$ nF

The effective internal inductance is negligibly small.

	IIC	resp.	IIB	
max. permissible external inductance	2	mH	5	mH
max. permissible external capacitance	500	nF	2,5	μ F

or

	IIC	resp.	IIB	
max. permissible external inductance	0,5	mH	2	mH
max. permissible external capacitance	750	nF	3	μ F

or

for the connection to a certified inductively conductivity measuring sensor type InPro725X/**/* appropriate EC-type-examination Certificate SEV 05 ATEX 0106 X

EP
(terminal 9)

for the connection to the equipotential bonding system



Prüf- und Zertifizierungsstelle

ZELM Ex



2. SUPPLEMENT OF THE EC-TYPE-EXAMINATION CERTIFICATE ZELM 00 ATEX 0038

References:

The conductivity measuring loop and the temperature measuring loop of the inductive conductivity measuring sensor type InPro725X/*/* are galvanically connected together.

Connecting the equipotential bonding is absolutely required to guarantee electrostatic leakage.

The BUS- / Supply loop is safely electrically isolated from the other loops up to a voltage of 60 V.

The operation manual has to be considered.

Report No.:

ZELM Ex 1010519416

Special conditions for safe use


not applicable

Essential Health and Safety Requirements

The essential Health and Safety Requirements are further met by concordance with the standards scheduled in the EC-Type-Examination Certificate.

Zertifizierungsstelle ZELM Ex

Braunschweig, September 30, 2005


Dipl.-Ing. Harald Zelm



Sheet 3 / 3

EC-type-examination Certificates without signature and stamp are not valid. The certificates may only be circulated without alteration. Extracts or alterations are subject to approval by the Prüf- und Zertifizierungsstelle ZELM Ex. This English version is based on the German text. In the case of dispute, the German text shall prevail.

Prüf- und Zertifizierungsstelle ZELM Ex • Siekgraben 56 • D-38124 Braunschweig